

**Photometric Measurement Report**

Generated by Radiant Vision Systems Light Measurement Platform

Luminaire Model	L SU2811002				
Led & Driver Type	SAMSUNG	5630	&	TRIDONIC	-
Luminaire Type	SURFACE MOUNTED				
Luminaire Family	MARKT				
Holder	-				
Reflector / Lens Degree	30				
Brand	LAMP 83				
Date of issue	21.09.2018				

**Test Standards**

EN 13032-1:2012 and EN 13032-4:2013 Light and Lighting. Measurement and presentation of photometric data of lamps and luminaires

IESNA LM-79-08 Approved Method: Electrical and Photometric Measurements of SSL Products(Type-C)

**Test and Test Method**

The photometric measurements listed in this report are performed by a Radiant Vision Systems PM-NFMS™ near field goniometer system. The NFMS system performs brightness and color measurements as a function of viewing angle. It provides accurate near-field luminance distribution data and generates far field distribution data.

**Test Equipment**

Name	Serial / Version
The PM-NFMS™ system consists of a PM-Series™ Imaging Colorimeter IC-PMI2	SN# 79046501
NFMS 800 two-axis goniometer	SN# 641502001
SP-1000 spectrometer	SN# 3017942276
PM-NFMS™ software	Version 4.9.9
ProSource™ Software	Version 10.2.2

The measurement data is preserved as a set of images Radiant Source Model™(RSMX). The ProSource™ Software (Version 10.2.2) was been used to convert the RSMX to a ray set(LTD file)

**Laboratory Environment and Conditions**

The measurement was done in the photometric laboratory of Lamp83 (Istanbul). It is a climate controlled dark room. Also a AC/DC power stabilisation unit is used(Pyramid Plus PPS310,8KW,10kVA,SN# 073010T0066).

Temperature:	25°C	(± 1 °C)
Moisture:	60%	(± 10 %)

The luminaire was thermally stabilized for **at least 45 minutes** on the goniometer. The end of the stabilization period has been reached if in the last 10 minutes the luminance output has not changed by more than  $\pm 0.5\%$ .

**Equipment Specifications**

Precision: 0.25° (NFMS Goniometer)

Luminance (Y):  $\pm 3\%$  (Imaging Colorimeter IC-PMI2)

Color Accuracy:  $\pm 0.002$  Illuminant A type source (Spectrometer SP-1000)

**Tested By:**

Gökhan AKSEL  
Test Technician

**Reviewed By:**

Anıl TOKER  
Physics Engineer

**Approved By:**

Erdoğan EMREM  
R&D Manager

LAMP83 Aydınlatma San. Ve Tic. A.Ş

Dudullu Organize Sanayi Bölgesi 2. Cadde No:22 PK: 34775 Ümraniye - İstanbul

## Photometric Measurement Report

Generated by Radiant Vision Systems Light Measurement Platform

## Luminaire Spectroradiometric Results

Luminous Flux (lm)	4383
CCT (K)	4,279
Cx	0.3677
Cy	0.3635
CRI	81
Luminous Efficacy (lm/W)	107.56
Angle (°)	29.0

## Luminaire Electric Specifications

Voltage (VAC)	221.1
Current (A)	0.19
Power (W)	40.74873
Power Factor	0.97
LED Voltage(VDC)	99.3
LED Current(mA)	358
LED Power(W)	35.5494


## Measurement Preset Specifications

External ND Filter	NO
ND Filter	ND3
F-Number	8
Exposure Time (ms)	141.6
Distance(mm)	3135


## Rendering Index

CRI	
R1	85.4
R2	90.3
R3	93.1
R4	86.2
R5	85.7
R6	86.0
R7	88.8
R8	74.1
R9	31.3
R10	76.3
R11	85.4
R12	70.4
R13	86.3
R14	96.1
CRI Ra	86.2


## Special CRI

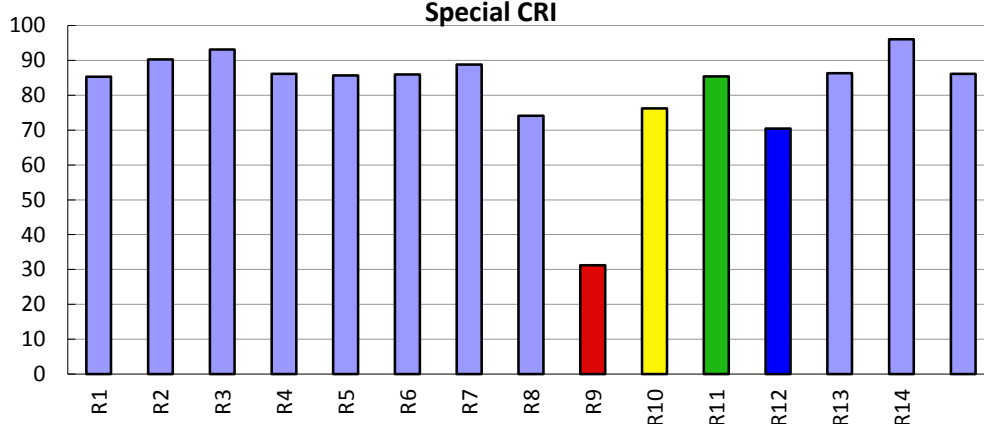

## CIE 1931 x,y Chromaticity Diagram

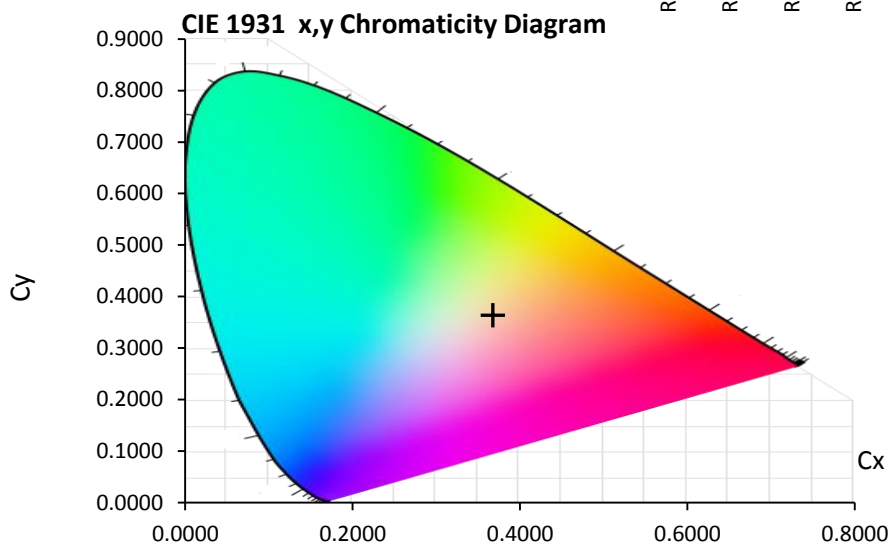

## Relative Spectral Power Distribution

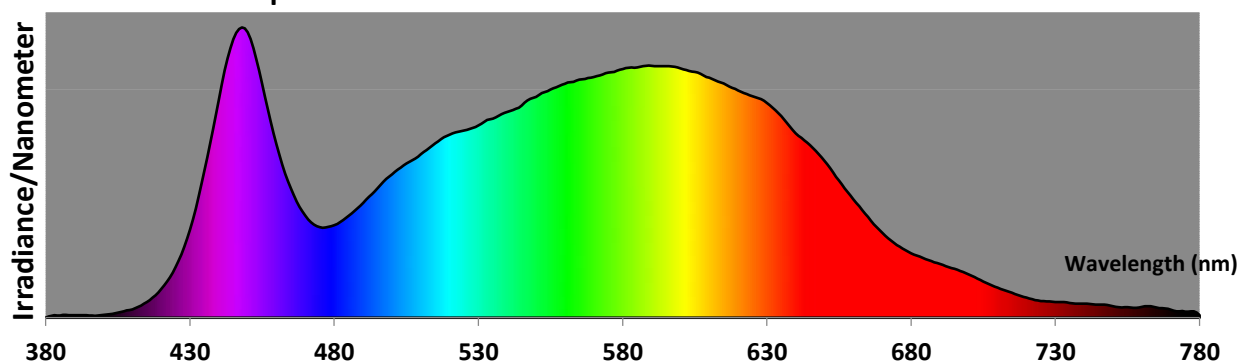


# Photometric Measurement Report


Generated by Radiant Vision Systems Light Measurement Platform

## Intensity Distribution - Polar Curve


Intensity Radar Plot (ray trace to infinity)

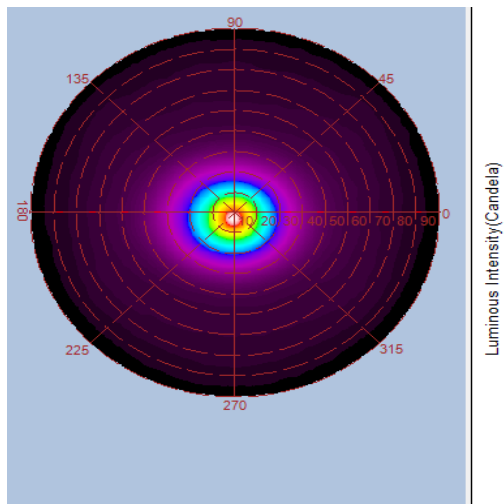

Luminous Intensity Distribution

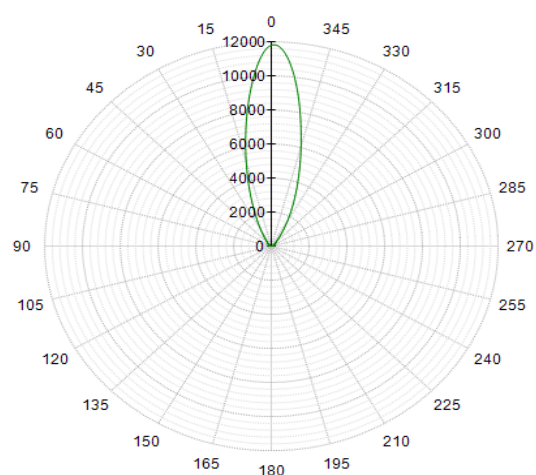

## Cone Diagram

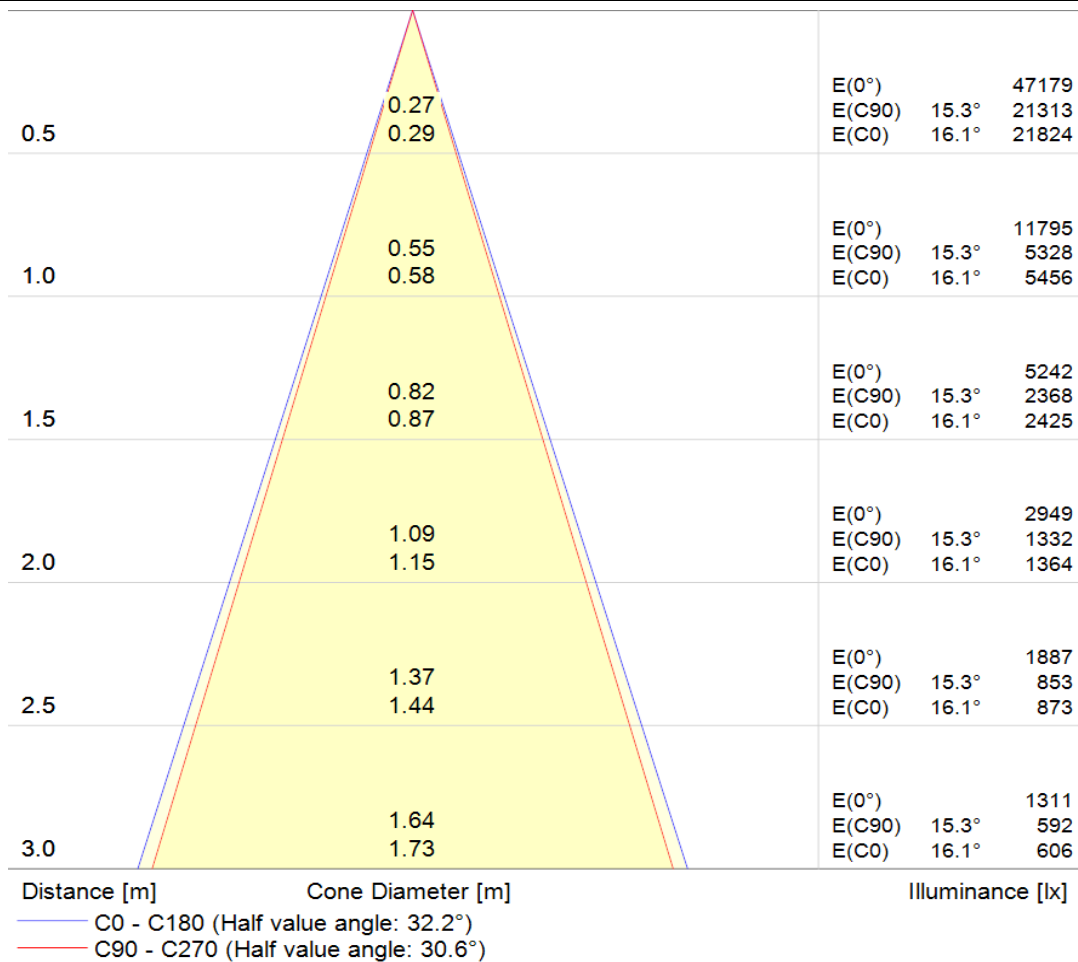

## Photometric Measurement Report

Generated by Radiant Vision Systems Light Measurement Platform

## UGR Table

## Glare Evaluation According to UGR

$\rho$ Ceiling		70	70	50	50	30	70	70	50	50	30
$\rho$ Walls		50	30	50	30	30	50	30	50	30	30
$\rho$ Floor		20	20	20	20	20	20	20	20	20	20
Room size X      Y		Viewing direction at right angles to lamp axis					Viewing direction parallel to lamp axis				
2H	2H	12.2	13.0	12.4	13.2	13.4	14.9	15.7	15.2	15.9	16.1
	3H	13.7	14.4	14.0	14.6	14.9	16.1	16.8	16.4	17.0	17.3
	4H	14.5	15.1	14.8	15.4	15.6	16.6	17.3	17.0	17.6	17.8
	6H	15.1	15.8	15.5	16.0	16.3	17.2	17.8	17.5	18.1	18.4
	8H	15.4	16.0	15.7	16.3	16.6	17.5	18.1	17.8	18.3	18.6
	12H	15.6	16.2	16.0	16.5	16.8	17.7	18.3	18.1	18.6	18.9
4H	2H	13.0	13.6	13.3	13.9	14.2	15.2	15.9	15.5	16.2	16.4
	3H	14.7	15.2	15.0	15.5	15.9	16.7	17.3	17.0	17.6	17.9
	4H	15.6	16.1	15.9	16.4	16.7	17.4	17.9	17.8	18.2	18.6
	6H	16.4	16.8	16.8	17.2	17.5	18.1	18.5	18.5	18.9	19.2
	8H	16.7	17.1	17.1	17.5	17.9	18.4	18.8	18.8	19.2	19.6
	12H	17.0	17.3	17.4	17.7	18.1	18.7	19.0	19.1	19.4	19.8
8H	4H	16.0	16.4	16.4	16.8	17.2	17.6	18.0	18.1	18.4	18.8
	6H	16.9	17.2	17.4	17.6	18.1	18.4	18.7	18.9	19.2	19.6
	8H	17.3	17.6	17.8	18.0	18.5	18.8	19.1	19.3	19.5	20.0
	12H	17.7	17.9	18.2	18.4	18.9	19.2	19.4	19.7	19.9	20.4
12H	4H	16.1	16.4	16.5	16.8	17.2	17.6	18.0	18.1	18.4	18.8
	6H	17.0	17.3	17.5	17.7	18.2	18.5	18.7	18.9	19.2	19.6
	8H	17.5	17.7	18.0	18.1	18.6	18.9	19.1	19.4	19.6	20.1
Variation of the observer position for the luminaire distance S											
S = 1.0H		+0.4 / -0.2					+0.8 / -0.4				
S = 1.5H		+1.0 / -0.4					+1.9 / -0.5				
S = 2.0H		+1.7 / -0.6					+3.1 / -0.7				
Standard table		BK07					BK06				
Correction summand		0.9					2.3				
Corrected glare indices referring to 4384lm total luminous flux											

## Sample Pictures